

**SPD**  
Surge Protective Device

**SPD for Photovoltaic System**



- Photovoltaic Inverter
- Distribution Power Unit (DPU)
- DC Lightning Protection Box
- DC Power Supply
- Energy Storage Converter
- DC Junction Box

SPD

SPD

## Glossary


Item	Description
$U_{cpv}$	<b>Maximum Continuous Operating Voltage for PV application</b> Maximum DC voltage, which may be continuously applied to the SPD's mode of protection. — (IEC 61643-31)
8/20 $\mu$ s	<b>8/20 Current Impulse</b> Current impulse with a nominal virtual front time of 8 $\mu$ s and a nominal time to half-value of 20 $\mu$ s. — (IEC 61643-31)
1.2/50 $\mu$ s	<b>1.2/50 Voltage Impulse</b> Voltage impulse with a nominal virtual front time of 1.2 $\mu$ s and a nominal time to half-value of 50 $\mu$ s. — (IEC 61643-31)
$I_{imp}$	<b>Impulse Discharge Current for Class I Test</b> Crest value of a discharge current through the SPD with specified charge transfer Q and specified energy W/R in the specified time. — (IEC 61643-31)
$I_n$	<b>Nominal Discharge Current</b> Crest value of the current through the SPD having a current waveshape of 8/20. — (IEC 61643-31)
$I_{max}$	<b>Maximum Discharge Current</b> Crest value of a current through the SPD having an 8/20 waveshape and magnitude according to the manufacturers specification. $I_{max}$ is equal to or greater than $I_n$ . — (IEC 61643-31)
$U_p$	<b>Voltage Protection Level</b> Maximum voltage to be expected at the SPD terminals due to an impulse stress with defined voltage steepness and an impulse stress with a discharge current with given amplitude and waveshape. — (IEC 61643-31)
<b>Modes of Protection</b>	<b>Modes of Protection</b> An intended current path, between terminals that contains protective components, for which the manufacturer declares a protection level. — (IEC 61643-31)
<b>IP</b>	<b>Degrees of Protection Provided</b> Classification preceded by the symbol IP indicating the extent of protection provided by an enclosure against access to hazardous parts, against ingress of solid foreign objects and possibly harmful ingress of water. — (IEC 61643-31)

# SPD

Surge Protective Device

## 型号说明 Part Numbering System

SD 25 T 100 L 2 11 PV -xxx

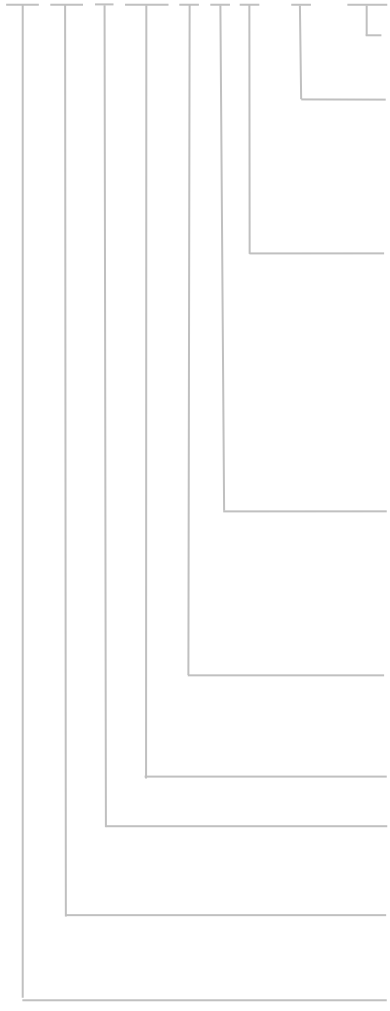

**Other Options**

**Modes of Protection**

Default: For AC systems  
 PV: For PV/DC systems

**Wire Connection**

- 00: One protection mode, for L-line
- 01: Split-phase system, 2W+G
- 02: Split-phase system, 3W+G
- 03: 2W+G One-phase or DC system, 2W+G
- 04: Three-phase system TT/TN (3+1)
- 05: Three-phase system (4+0) or Single-phase system (2+0)
- 06: Three-phase system IT (3+0)
- 11: U shape construction for PV/DC system
- 12: Y shape construction for PV/DC system
- 16: Three-phase system TT/TN (3+1), N-PE has GDT without trip

**Characteristic code**

- 1: One pole
- 2: Two poles
- 3: Three poles
- 4: Four poles

**Circuit Characteristic**

A: With GDT  
 L: 2+0,3+0,4+0 without GDT  
 F: 3+1, N-PE has GDT without trip

**Nominal System Voltage**

150 V, 230 V, 270 V, 320 V

**Design Sequence**




T R H S C

**Nominal Discharge Current**

20: 20 kA  
 25: 25 kA  
 30: 30 kA

**Product Category**

## Agency Information

Agency Information		Standards	NO.	Category
	UL	UL 1449 4th Edition	E322662	VZCA2
	CUL	CSA C22.2 NO.269, CSA ECN 516	E322662	VZCA8
	TUV	IEC/EN 61643-11, IEC/EN 61643-31	See the different models for details	

# SPD

Surge Protective Device



## ATTENTION

### Usage

1. The voltage applied continuously to the SPD must not exceed its maximum continuous operating voltage  $U_c$ .
2. When atmosphere press is from 45 kPa to 106 kPa, the related altitude shall be from 5000 m to - 500 m.
3. Do not touch the product body or wires directly when power is on, to avoid electric shock.

### Replacement

As SPD is a non-repairable product, for safety sake, please use the same type of SPD for replacement.

### Storage

Do not store SPD at high temperature, high humidity or corrosive gas environment, to avoid oxidation of the wires. Use them up within 2 years after receiving the goods.


### Installation

1. Installation and startup may only be carried out by qualified personnel. The relevant country-specific regulations must be observed.
2. Check the device for external damage before installation. If the device is defective, it must not be used.
3. Pay attention to risk of electric shock. Please cutoff all electrical power before installation or service.
4. Lay the output cables to the surge protective devices (SPDs) as short as possible, without loops.
5. Do not apply mechanical stress to the SPD body during or after the installation.

### Maintenance

1. Check SPD status according to instructions before and after the thunderstorm season each year.
2. If the indicator of "failure state" appears, the SPD is damaged. Replace the SPD with same type.
3. Ensure electrical connections and mountings are correct before energizing the circuit.
4. SPD`s quality is well controlled and strictly inspected before delivery. If non-functional ones are found during operation, please contact us early enough.

## Wiring Diagram

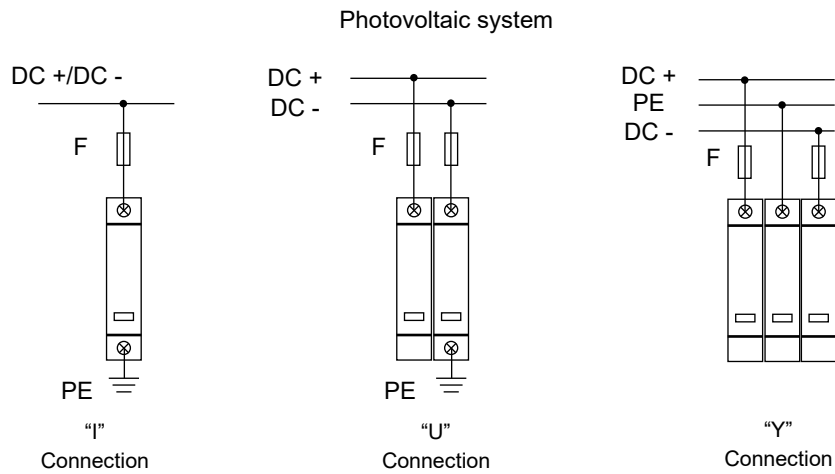

## Specifications

Features	Specifications
Degrees of Protection Provided	IP20
Wiring Ability	(1.5 to 25) mm <sup>2</sup> (Flexible) / 35 mm <sup>2</sup> (Rigid)
Installation	35 mm DIN rail
Alarm	Remote + Indicator
Operating State / Fault Indication	Green / Red
Remote Indication Contacts	AC: 250 V / 0.5 A , 125 V / 1.0 A DC: 250 V / 0.1 A , 125 V / 0.2 A , 75 V / 0.5 A
Cross-section of Remote Indication Conductors	1.5 mm <sup>2</sup>
Short Current Rating $I_{SCCR}$	1000 A
According to Standard	UL 1449, EN 61643-31
Altitude	0 ~ 5000 m
Operational Temperature Range	(-40 to 85) °C



**SPD**

Surge Protective Device

SD25TxxxL211PV

**Dimensions (mm)**

**Schematics**

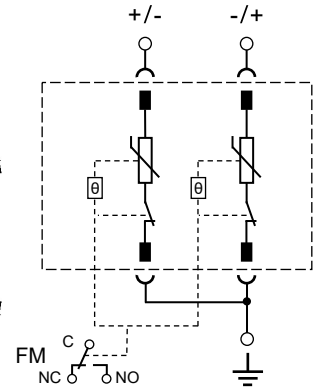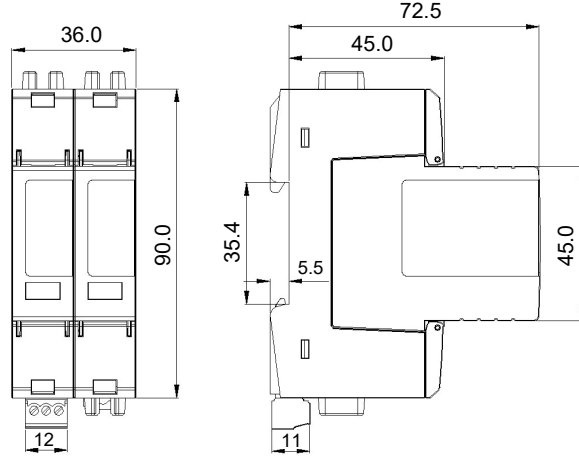

- For DC / PVDC System
- Class I and Class II SPD
- Over-temperature Protection, Overcurrent Protection, High Reliability
- Comply with IEC 61643-31 and UL 1449

**Specifications**

Model	Nominal System Voltage ( $U_n$ )	Max. Continuous Operating Voltage for PV application ( $U_{cpv}$ )	Impulse Discharge Current (10/350 $\mu$ s) ( $I_{imp}$ )	Nominal Discharge Current (8/20 $\mu$ s) ( $I_n$ )	Max. Discharge Current (8/20 $\mu$ s) ( $I_{max}$ )	Voltage Protection Level ( $U_p$ )	Modes of Protection	SPD Type
SD25T100L211PV	100 VDC	180 VDC	12.5 kA	25 kA	50 kA	1.0 kV	+/- — PE	T1+T2
SD25T200L211PV	200 VDC	250 VDC	12.5 kA	25 kA	50 kA	1.3 kV		
SD25T300L211PV	300 VDC	330 VDC	12.5 kA	25 kA	50 kA	1.5 kV		
SD25T400L211PV	400 VDC	450 VDC	11 kA	25 kA	50 kA	2.0 kV		
SD25T500L211PV	500 VDC	550 VDC	10 kA	25 kA	50 kA	2.1 kV		
SD25T600L211PV	600 VDC	670 VDC	7.5 kA	25 kA	50 kA	2.5 kV		
SD25T800L211PV	800 VDC	895 VDC	5.0 kA	25 kA	50 kA	3.2 kV		